


Q M.H.

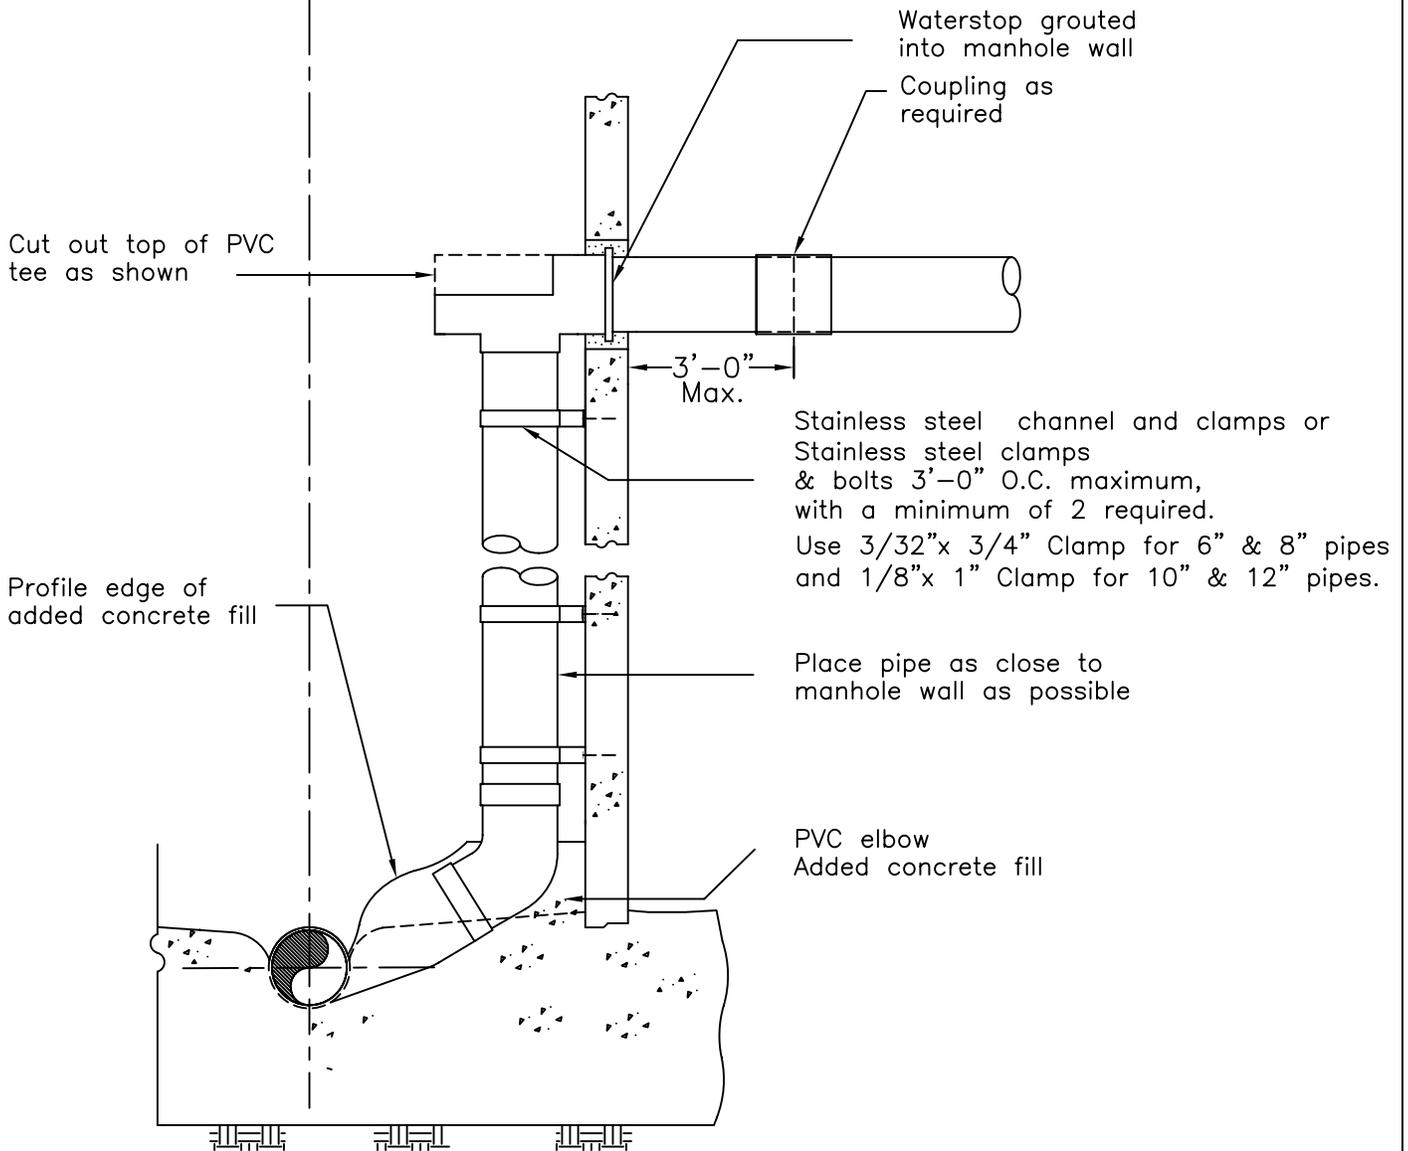

NOTES:

1. Manholes constructed using this standard shall be 60" in diameter and installed in conformance with City Standard. Use 72" MH where there are two drop connections.
2. Enclose elbow in concrete. Form smooth channel with sweep to manhole flowline.
3. Install waterstop in accordance with manufacturer's instructions as shown.
4. PVC pipe and fittings shall have same nominal size and SDR rating as incoming pipes.

City of Lakeport

INSIDE
DROP MANHOLE

SCALE: NONE		DATE: Jan 2003	
DWN:	MEB	APPROVED	
CHK:		FILE NO.	