NOTES:

1. ALL CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE CITY OF LAKEPORT CONSTRUCTION STANDARDS AND STANDARDS FOR PUBLIC WORKS CONSTRUCTION (GREEN BOOK, LATEST EDITION).
2. JOINTS ARE TO BE FLANGED OR RESTRAINED ONLY (NO PUSH ON FITTINGS).
3. FIRE HYDRANTS ARE TO BE 5¼" DRY BARREL WITH (1) 4½" & (2) 2½" NOZZLES.
4. APPROVED HYDRANTS:
   A. AMERICAN DARLING B-62-B
   B. CLOW – MEDALLION
   C. KENNEDY – GUARDIAN
   D. WATEROUS
5. HYDRANT BURY DEPTH MAY VARY WITH PRIOR APPROVAL OF THE CITY ENGINEER.
6. PRIVATE ON SITE HYDRANT LOCATIONS TO BE APPROVED BY THE GOVERNING FIRE DISTRICT.
7. NON-FLANGED FITTINGS ARE TO BE MECHANICALLY RESTRAINED.

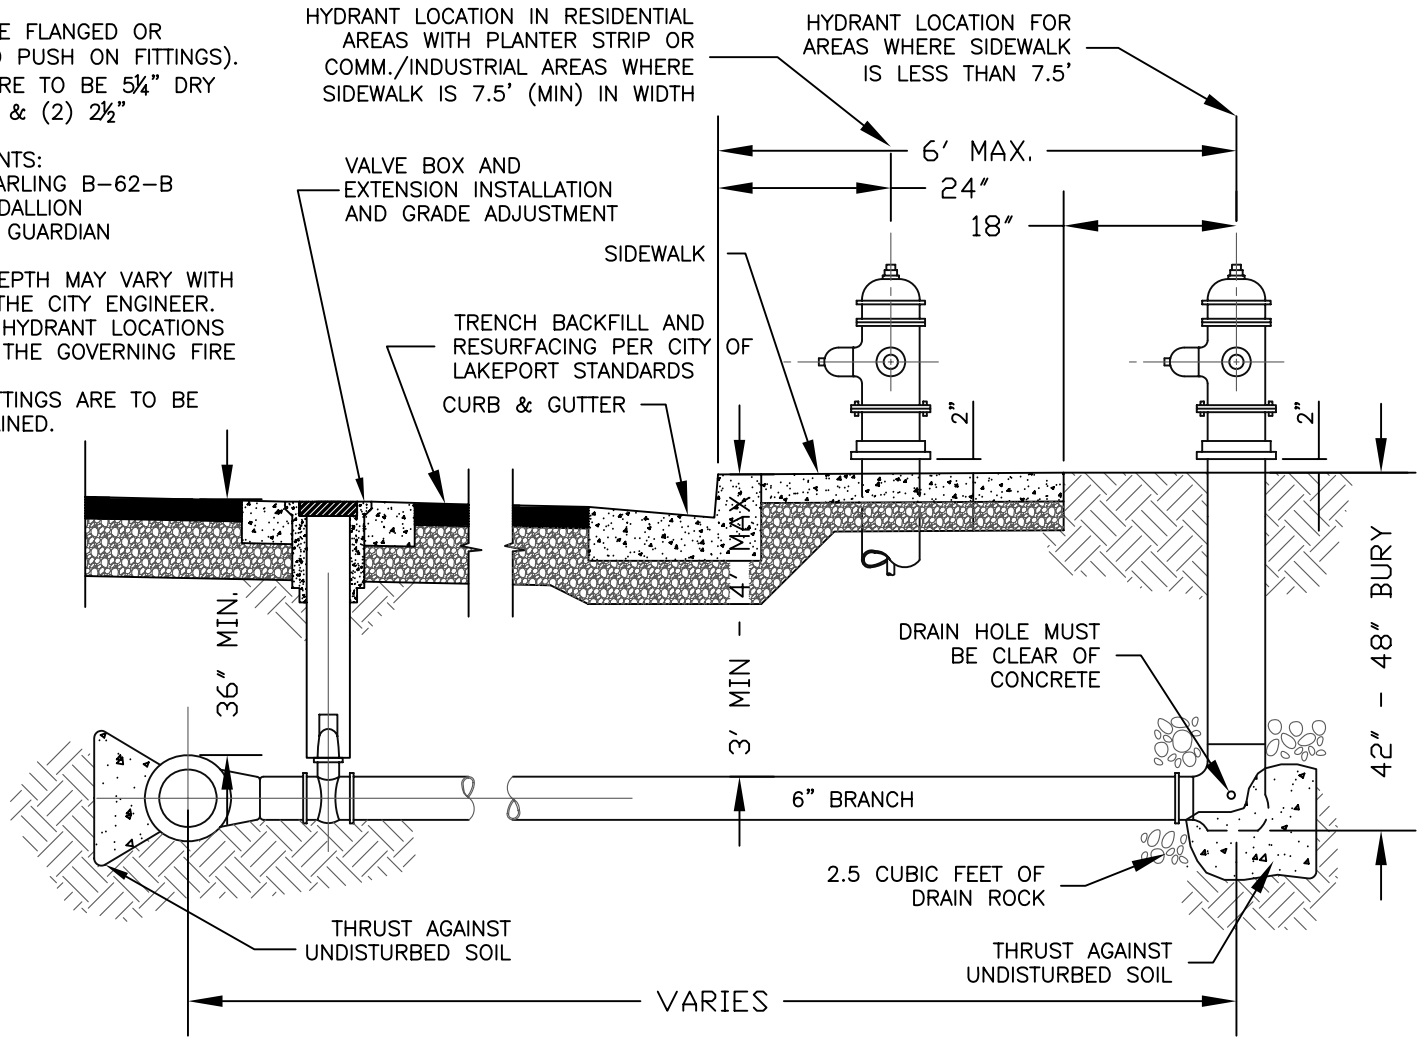

REVISIONS

Description	By	Approved	Date

CITY OF LAKEPORT

FIRE HYDRANT DETAIL

Drawn By: SMH
Checked By: MB
Approved: 5/2005

SCALE: N.T.S
DRWG. NO.: